SPLIT SYSTEM

SADE - SERIES

Nominal Sizes 11/2 to 6 Tons





CLASSICX®

HIGH EFFICIENCY CONDENSING UNITS 50 Hertz

HEAVY DUTY

The Rheem Classic X High Efficiency SADE -Condensing Unit was designed with performance in mind. These units offer comfort, energy conservation and dependability for single, multi-family and light commercial applications.

The Rheem Classic X - Condensing Units are the result of an ongoing development program for improved efficiencies. With SEER's ranging to 10.50, these units continue a tradition of high efficiency.

- Attractive, louvered wrap-around jacket protects the coil from yard hazards and weather extremes. Top grille is steel reinforced for extra strength. Cabinet is powder painted for all-weather protection.
- 1008 hours salt spray test successfully conducted on the cabinet.
- Air is discharged upward away from bushes and shrubs. The discharge pattern of the top grille provides minimum air restriction, resulting in quiet fan operation.
- Exclusive Combination Grille/Motor Mount secures the motor to the underside of the discharge grille.
- All controls are accessible by removing one service panel.
 Removable top grille provides access to the condenser fan motor, condenser coil and Compressor.
- Single speed fan motor is designed for low speed, quiet, energy-saving operation.

SBHC - SERIES






TESTED IN ACCORDANCE WITH A.R.I. STANDARD NO. 2-10-81-360-86







All controls and compressor are accessible for servicing by removal of its service panels.



DO NOT OBSTRUCT DRAIN SLOTS (SHADED).

Drawn Galvanized Base Pan.

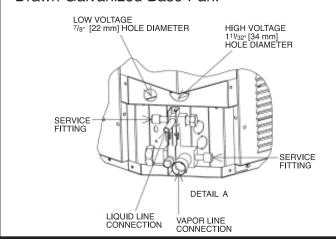

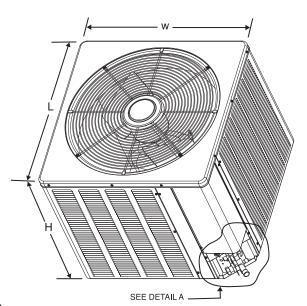

Engineering Features Condensing Units

- Compressor is hermetically sealed and incorporates internal high temperature motor overload protection, and durable insulation on the motor windings. It is internally spring mounted and externally mounted on rubber grommets to reduce vibration and noise.
- 2. Compressors have an internal pressure-relief assembly to protect against excessive pressure differential.
- 3. All refrigerant connections are on the exterior of the units, located close to the ground for neat appearing installations.
- Cabinet is constructed of powder painted galvanized steel. The full wraparound louvered grille protects the coil from damage.
- Copper Tube Aluminium Fin coils are used on all models.
- The control box is located on the top side corner of the cabinet providing for easy access through a service panel.
- 7. Service valves are standard on all models.
- 8. Power and control wiring are kept separate.
- 9. Every unit is factory charged and tested.
- 10. Drawn, galvanized base pan for extra corrosion resistance and sound reduction.
- 11. High Pressure Control and Low Pressure Control, are provided as a standard feature.

Field Installed Accessories

- Time Delay Control Compressor will remain off for five minutes after power or thermostat interruption, allowing system pressures to equalize. Starting during high pressure conditions can result in shortened compressor life.
 - (Model No. RXMD-B01)
- Low Ambient Switch Cycles outdoor fan to maintain adequate condensing pressures assuring liquid refrigerant flow to the coil. Allows indoor cooling with outdoor temperatures down to 0°F. (Model No. RXAD-A04)
 - It is recommended that this control be installed in units to be operated at outdoor ambient temperatures under 70°F.
- Hard Start Kits Available through the Parts Department.
- Crankcase Heater Available through the Parts Department.

Model No.		Unit Dimensions	
SADE	Width "W" Inches [mm]	Length "L" Inches [mm]	Height "H" Inches [mm]
018, 024, 030, 036, 042	235/8 [600.07]	235/8 [600.07]	241/4 [615.95]
048, 060, 065	315/8 [803.27]	315/8 [803.27]	27 ¹⁵ / ₁₆ [709.61]

Condensing Units - Electrical and Physical Data

			ELE	CTRICAL	_					P	PHYSICA	.L	
Model	Phase	Compr	Compr	Fan	Min.Circuit	Fuse o	r HACR	Outo	door Coil		R-22	We	ight
No.	Hertz	FLA	LRA	Motor	Ampacity	Circuit	Breaker	Face Area	No.	CFM		Net	Shipping
	Volts			FLA	Amps	Min. Amps.	Max. Amps	Sq. Ft.	Rows		Oz	Lbs.	Lbs.
018S	1-50-220	9.9	45	0.9	14	20	20	5.33	1	1585	40.0	130	138
024S	1-50-220	12.7	57	0.9	17	20	25	8.51	1	1375	51.0	135	143
030S	1-50-220	15.5	70	0.9	21	25	35	8.51	1	1375	60.0	135	143
036S	1-50-220	18.3	82	1.3	25	30	40	11.14	1	1835	71.0	140	148
036N	3-50-380	5.5	42	0.6	8	15	15	11.06	1	1835	71.0	140	148
042S	1-50-220	17.3	97	1.1	23	30	40	11.06	1	1835	81.6	145	153
042N	3-50-380	6.4	45	0.6	9	15	15	11.06	1	1835	81.6	145	153
048S	1-50-220	20.0	102	1.5	27	35	45	12.43	1	2375	104.0	167	177
048N	3-50-380	7.7	50	1.0	11	15	15	12.43	1	2375	104.0	167	177
060N	3-50-380	9.6	70	1.0	14	20	20	16.39	1	3000	96.0	180	188
065N	3-50-380	9.6	82	1.0	14	20	20	16.39	1	3000	96.0	181	190

Air Handlers - Blower Motor Electrial Data at 50 Hz.

Model Size/Elec. Designation	Voltage	Phase	Hertz	НР	RPM	Circuit Amps	Minimum Circuit Ampacity	Maximum Circuit Protector
-14T	220	1	50	1/6	750	1.3	1.7	15
-17T	220	1	50	1/4	750	2.1	2.7	15
-21T	220	1	50	1/3	750	3.2	4.0	15
-24TH	220	1	50	1/2	825	3.7	4.5	15

Air Handlers - Air flow Performance Data at 50 Hz.

Model	Electric	Blower Motor		CFM / Exte	rnal Static Pressur	e - In. W.C.	
Cabinet Size	Heaters	Speed	0.1	0.2	0.3	0.4	0.5
4.4	None	Low	792	759	719	672	619
-14	None	High	941	904	859	804	740
47	None	Low	1226	1182	1133	1077	1015
-17	None	High	1342	1292	1233	1167	1093
-21	None	Low	1636	1596	1546	1485	1413
-21	None	High	1772	1724	1667	1600	1524
-24H	None	Low	2070	2038	2004	1957	1897
-2411	None	High	2319	2269	2218	2157	2081


Engineering Features


Air Handler

The most compact unit design available, all air handler models only 35 inches high/long in case of horizontal application

- Attractive pre-painted cabinet exterior.
- Rugged wall steel cabinet construction, designed for added strength and versatility.
- Quiet-efficient 8-pole blower motors provide nominal airflow to .5 inches or more external duct static.
- Four leg flexible blower motor mount.
- Circuit breakers standard on 1-phase models above 11 KW and optional on models with 11 KW or less.
- Models supplied with circuit breakers meet UL and CSA requirements as a service disconnect switch.
- Provisions for field electrical, refrigerant and drain connections from either side of air handler cabinet.
- All single phase models above 11 KW are available with multiple electrical supply circuits or single electrical supply circuit. Kits and parts available for field conversion either way.
- Tab lock blower housing with intergrated electric heaters, controls, motor and blower. Slide out design for service and maintenance convenience.
- Optional, exclusive dependable stainless steel sheath type electric heating elements located in the blower housing provide mixed warm air without cold spots.
- Factory configurated or field convertible for vertical upflow, vertical downflow, horizontal right hand or left hand air supply.
- Separate return air filter compartment provided with thumb screw openable access panel to easily service / remove the filter.

- Common combustible floor base accessory fits all model sizes when required for downflow installations on combustible floors.
- Durable framed cleanable air filter provided as standard in unit filter rack.
- MultiFlex[™] indoor coil design provides low air side pressure drop, high performance and extremely compact size
- Flow check piston on indoor coil provides for operation with air conditioning or heat pump using the same coil. (Some models require piston size change.)
- All indoor coils have copper tubing and aluminum fins.
- Molded polymer corrosion resistant condensate drain pan is provided on all indoor coils.
- Common size horizontal drain pan kit fits all coil sizes and all air handler model sizes.
- Both supply and return duct flanges provided as standard on air handler cabinet.
- Connection points for both high voltage and low voltage control wiring inside air handler cabinet.
- ⁷/₈ inch knockouts are provided for power connection to cabinet. Installer may pull desired hole size up to 2 inches for 1¹/₂ inch conduit.
- Patented watt restrictor on heat pump models to control electric heat during heating operation.
- Front refrigerant and drain connections.

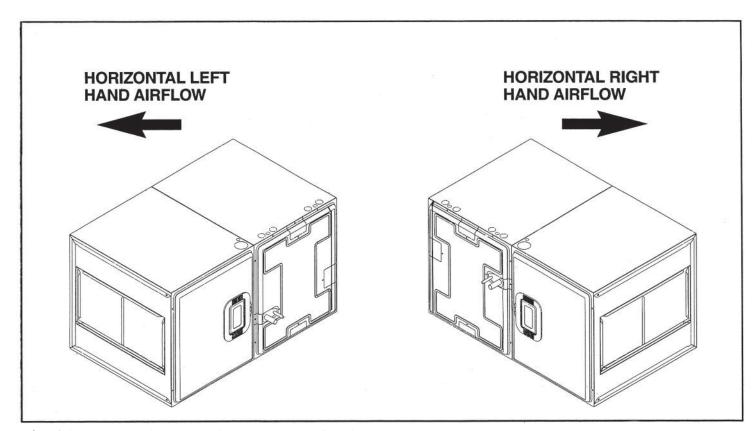

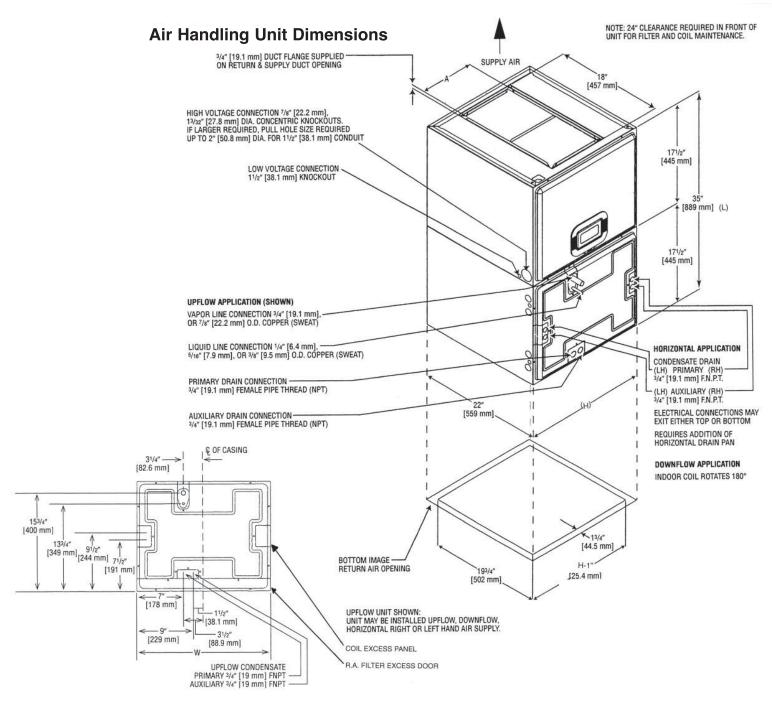

Specification Data

Blower	Indoor Coil	Cooling Capacity Range	Blower Size	Max Cfm at 0.1" ESP	Cool Speed	Filter Inches
-14	RCBA-2457	11/ ₂ -2 TR	11.9 x 3.81	941/792	HI / LO	12.75 x 21
-17	RCBA-3765	2½-3 TR	11.9 x 5.29	1342/1226	HI / LO	16.25 x 21
-21	RCBA-4882	3½-4 TR	11.9 x 7.12	1772/1636	HI / LO	19.75 x 21
-24H	RCBA-6089	5 - 6 TR	11.9 x 9.50	2319/2070	HI / LO	23.25 x 21

Unit Dimensions & Weights

Offic Difficusion	is a weig	Jiilo						
Model	U	nit	Sup	ply	Unit Weight/Sl	nipping Weight	Max. I	leater
Number	"	H "	Duc	t "A"	Unit W	ith Coil	Elem	ents
	In.	mm.	In.	mm.	Lbs.	KG.	No.	KW
-14	14	356	6 ³ / ₃₂	155	81 / 88	37 / 40	3	15
-17	17 ¹ / ₁₂	434	7 ⁹ / ₁₆	192	92 / 99	42 / 65	4	20
-21	21	534	9 ⁷ / ₁₆	240	109 / 117	49 / 53	5	25
-24H	24 ¹ / ₂	623	11 ³ / ₄	298	125 / 134	57 / 61	6	30

 $\ensuremath{\text{NOTE:}}$ Subtract 1.5 lbs/ 0.6 kg for each heater element less than maximum.

				SA	DE0	18/SE	BHC1	4						S	ADE0)24/S	BHC ²	14		
	IND	OOR TEMP °F	80	DB/71V	VΒ	80	DB/67V	VB	80	DB/63V	VΒ	80	DB/71V	VB	80	DB/67V	VB	80	DB/63V	VB
	С	M AIR VOL.	900	860	740	900	860	740	900	860	740	900	860	740	900	860	740	900	860	740
	DE	P.RATIO ①	0.24	0.27	0.31	0.24	0.27	0.31	0.24	0.27	0.31	0.29	0.29	0.31	0.29	0.29	0.31	0.29	0.29	0.31
		Total MBH	20.3	19.6	18.8	19.6	19.0	18.2	18.4	17.8	17.0	25.7	24.8	23.8	24.8	24.0	23.0	23.3	22.6	21.5
0	80	Sens MBH	12.2	11.5	10.7	15.6	14.3	13.3	17.5	16.2	15.0	15.4	14.5	13.6	19.7	18.1	16.9	22.1	20.5	18.9
U		Power KW	1.3	1.3	1.3	1.3	1.3	1.2	1.3	1.2	1.2	1.7	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.5
Т		Total MBH	20.1	19.4	18.6	19.3	18.8	18.0	18.2	17.7	16.8	25.4	24.6	23.6	24.5	23.8	22.8	23.1	22.3	21.3
	85	Sens MBH	12.1	11.3	10.6	15.4	14.2	13.2	17.4	16.3	15.2	15.3	14.3	13.4	19.4	17.9	16.7	22.1	20.7	19.2
		Power KW	1.4	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.2	1.7	1.7	1.7	1.7	1.7	1.6	1.6	1.6	1.6
D		Total MBH	19.9	19.3	18.5	19.3	18.6	17.9	18.1	17.5	16.6	25.2	24.4	23.4	24.4	23.6	22.6	22.9	22.1	21.1
0	90	Sens MBH	11.9	11.2	10.5	15.3	14.2	13.0	17.3	16.2	15.1	15.0	14.2	13.2	19.3	17.9	16.5	22.1	20.5	19.1
0		Power KW	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.3	1.9	1.8	1.7	1.9	1.8	1.7	1.7	1.7	1.7
R		Total MBH	18.9	18.2	17.5	18.3	17.7	16.9	17.2	16.6	15.8	23.9	23.1	22.1	23.1	22.4	21.4	21.7	21.0	20.0
	95	Sens MBH	11.6	11.0	10.3	15.1	13.8	12.9	17.2	16.1	14.9	14.7	14.0	13.0	19.1	17.5	16.3	21.7	20.3	18.8
_		Power KW	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.9	1.9	1.8	1.9	1.8	1.8	1.8	1.8	1.7
T	400	Total MBH	18.5	17.9	17.2	18.0	17.4	16.6	16.8	16.3	15.5	23.5	22.7	21.8	22.7	22.0	21.1	21.3	20.6	19.6
E	100	Sens MBH	11.4	10.7	9.9	14.9	13.7	12.6	16.8	16.1	14.9	14.4	13.5	12.6	18.8	17.4	15.9	21.3	20.3	18.8
M		Power KW Total MBH	1.5 17.8	1.5 17.2	1.4	1.5	1.4 16.7	1.4 16.0	1.4 16.2	1.4 15.7	1.4 14.9	1.9	1.9	1.9	1.9 21.9	1.9 21.2	1.9 20.3	1.9	1.9	1.8 18.9
E	105	Sens MBH	17.8	17.2	16.6 9.6	17.3 14.6	13.4	12.3	16.2	15.7	14.9	22.6 14.1	21.8 13.2	21.0 12.2	18.5	17.0	20.3 15.5	20.5 20.5	19.8 19.8	18.9
R	105	Power KW	1.5	1.5	1.5	14.6	1.5	1.4	1.5	1.4	1.4	2.0	2.0	1.9	2.0	17.0	1.9	1.9	1.9	1.9
A		Total MBH	17.2	16.7	16.0	16.7	16.2	15.5	15.7	15.2	14.5	21.8	21.1	20.3	21.1	20.5	19.6	19.8	19.2	18.3
Ϊ́	110	Sens MBH	10.8	10.7	9.3	14.3	13.1	12.0	15.7	15.2	14.5	13.7	12.7	11.7	18.1	16.6	15.1	19.8	19.2	18.3
ΰ	110	Power KW	1.6	1.6	1.6	16	1.6	1.6	1.6	1.6	1.6	2.1	2.1	2.1	2.1	2.1	2.0	2.1	2.0	2.0
R		Total MBH	16.7	16.1	15.5	16.1	15.6	15.0	15.1	14.7	13.9	21.1	20.4	19.6	20.4	19.8	18.9	19.1	18.6	17.7
E	115	Sens MBH	10.5	9.7	9.0	14.0	12.9	11.7	15.1	14.7	13.9	13.3	12.3	11.4	17.7	16.3	14.8	19.1	18.6	17.7
_		Power KW	1.7	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	2.2	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
		Total MBH	16.2	15.6	15.0	15.7	15.2	14.5	14.7	14.2	13.5	20.5	19.8	19.0	19.8	19.2	18.4	18.6	18.0	17.1
°F	120	Sens MBH	10.1	9.3	8.6	13.6	12.4	11.3	14.7	14.2	13.5	12.8	11.8	10.9	17.2	15.7	14.3	18.6	18.0	17.1
		Power KW	1.7	1.7	1.7	1.7	1.7	1.6	1.7	1.6	1.6	2.2	2.2	2.2	2.2	2.2	2.1	2.2	2.1	2.1

				SA	DE0	30/SE	BHC1	7						S	ADE)36/S	BHC [,]	17		
	IND	OOR TEMP °F	80	DB/71V	VB	80	DB/67V	VB	80	DB/63V	VB	80	DB/71V	VB	80	DB/67V	VB	80	DB/63V	VB
	С	FM AIR VOL.	1300	1250	1100	1300	1250	1100	1300	1250	1100	1300	1250	1100	1300	1250	1100	1300	1250	1100
	DE	P.RATIO ①	0.26	0.28	0.30	0.26	0.28	0.30	0.26	0.28	0.30	0.28	0.29	0.31	0.28	0.29	0.31	0.28	0.29	0.31
		Total MBH	31.7	30.7	29.4	30.7	29.7	28.5	28.8	27.9	26.6	38.1	36.9	35.4	36.9	35.7	34.3	34.6	33.5	32.0
0	80	Sens MBH	19.1	17.9	16.8	24.4	22.4	20.8	27.4	25.3	23.4	22.9	21.6	20.2	29.3	26.9	25.1	32.9	30.4	28.1
U		Power KW	2.2	2.1	2.1	2.1	2.1	2.0	2.1	2.0	2.0	2.5	2.4	2.4	2.4	2.4	2.3	2.4	2.3	2.2
Т		Total MBH	31.4	30.4	29.2	30.3	29.4	28.2	28.6	27.6	26.3	37.7	36.6	35.0	36.4	35.4	33.9	34.3	33.2	31.6
	85	Sens MBH	18.9	17.7	16.6	24.0	22.2	20.6	27.2	25.5	23.7	22.7	21.3	20.0	28.9	26.7	24.8	32.7	30.7	28.5
		Power KW	2.2	2.2	2.2	2.2	2.2	2.1	2.1	2.1	2.0	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.3
D		Total MBH	31.1	30.2	28.9	30.1	29.2	28.0	28.3	27.4	26.1	37.4	36.3	34.7	36.2	35.0	33.6	34.0	32.9	31.3
0	90	Sens MBH	18.6	17.5	16.4	23.9	22.2	20.4	27.1	25.3	23.7	22.3	21.4	19.7	28.7	26.6	24.5	33.5	30.4	28.4
0		Power KW	2.4	2.3	2.2	2.4	2.3	2.2	2.2	2.2	2.2	2.7	2.6	2.5	2.7	2.6	2.5	2.5	2.5	2.4
R		Total MBH	29.5	28.6	27.4	28.6	27.7	26.5	26.8	26.0	24.7	35.5	34.3	32.9	34.4	33.3	31.9	32.3	31.2	29.7
	95	Sens MBH	18.1	17.3	16.1	23.7	21.8	20.2	26.8	25.1	23.3	21.8	20.8	19.4	28.5	25.5	24.3	32.3	30.2	28.0
		Power KW	2.4	2.4	2.3	2.4	2.3	2.3	2.3	2.3	2.2	2.7	2.7	2.6	2.7	2.6	2.6	2.6	2.6	2.5
T		Total MBH	29.0	28.0	26.9	28.1	27.2	26.1	26.3	25.5	24.3	34.9	33.7	32.3	33.8	32.7	31.3	31.6	30.6	29.2
Е	100	Sens MBH	17.8	16.8	15.6	23.3	21.5	19.7	26.3	25.1	23.3	21.4	20.1	18.7	28.0	25.8	23.6	31.6	30.2	28.0
M		Power KW	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.3	2.8	2.8	2.7	2.8	2.7	2.7	2.7	2.7	2.6
P		Total MBH	27.9	27.0	25.9	27.0	26.2	25.1	25.3	24.5	23.3	33.5	32.4	31.2	32.5	31.5	30.1	30.4	29.5	28.1
E	105	Sens MBH	17.4	16.3	15.0	22.8	21.0	19.2	25.3	24.5	23.3	20.9	19.6	18.1	27.4	25.3	23.1	30.4	29.5	28.0
R	-	Power KW	2.5	2.5	2.4	2.5	2.4	2.4	2.4	2.4	2.4	2.8	2.8	2.7	2.8	2.7	2.7	2.7	2.7	2.7
A		Total MBH	27.0	26.1	25.1	26.1	25.3	24.3	24.5	23.7	22.6	32.4	31.4	30.1	31.4	30.4	29.2	29.5	28.5	27.2
T	110	Sens MBH	16.9	15.8	14.5	22.4	20.6	18.7 2.6	24.5	23.7	22.6	20.3	18.9	17.4	26.9 3.0	24.7	22.5	29.5	28.5	27.2
U	-	Power KW	2.6 26.1	2.6	2.6 24.2	2.6 25.3	2.6 24.5		2.6	2.6 23.0	2.6	3.0	3.0	3.0 29.1	30.4	3.0	2.9 28.1	3.0 28.5	2.9 27.6	2.9
R E	11E	Total MBH Sens MBH	16.4	25.3 15.2		25.3 21.9	24.5	23.4 18.3	23.7	23.0	21.8 21.8	31.4 19.7	30.4 18.3		26.3	29.4 24.2	28.1	28.5 28.5	27.6 27.6	26.2 26.2
=	1115	Power KW	2.8	2.7	14.0 2.7	21.9	20.1	2.6	23.7 2.7	23.0	21.8	3.1	3.1	16.9 3.1	3.1	3.1	3.0	28.5 3.1	3.0	3.0
		Total MBH	25.3	24.5	23.5	24.5	23.7	22.8	23.0	22.2	21.2	30.4	29.4	28.2	29.5	28.5	27.4	27.6	26.7	25.5
°F	400																			
Г	120	Sens MBH	15.8	14.6	13.5	21.2	19.5	17.7	23.0	22.2	21.2	19.0	17.5	16.3	25.5	23.4	21.3	27.6	26.7	25.5 3.1
		Power KW	2.8	2.8	2.8	2.8	2.8	2.7	2.8	2.7	2.7	3.2	3.1	3.1	3.1	3.1	3.1	3.1	3.1	

POWER KW = UNIT INPUT K.W.

NOTE : ① WHEN THE ENTERING AIR INDOOR DRY BULB IS OTHER THAN 80° F [26.7° C], ADJUST THE SENSIBLE CAPACITY FROM THE TABLE BY ADDING [$1.10 \times CFM \times (1 - DR) \times (dbE - 80)$]

				SA	DE0	42/SE	BHC2	1						S	ADE)48/S	внс	21		
	INE	OOR TEMP °F	80	DB/71V	VB	80	DB/67V	VB	80	DB/63V	VB	80	DB/71V	VB	80	DB/67V	VB	80	DB/63V	VB
	С	FM AIR VOL.	1750	1700	1520	1750	1700	1520	1750	1700	1520	1750	1700	1520	1750	1700	1520	1750	1700	1520
	DI	EP.RATIO ①	0.25	0.28	0.30	0.25	0.28	0.30	0.25	0.28	0.30	0.28	0.29	0.30	0.28	0.29	0.30	0.28	0.29	0.30
		Total MBH	45.6	44.1	42.3	44.1	42.6	40.9	41.3	40.1	38.2	50.5	48.8	46.8	48.8	47.3	45.4	45.8	44.4	42.3
0	80	Sens MBH	27.4	25.8	24.2	35.1	32.1	29.9	39.3	36.3	33.6	30.3	28.6	26.8	38.9	35.6	33.2	43.6	40.3	37.3
U		Power KW	3.0	2.9	2.9	2.9	2.9	2.8	2.9	2.8	2.7	3.4	3.3	3.3	3.3	3.3	3.2	3.3	3.2	3.1
T		Total MBH	45.1	43.7	41.9	43.5	42.3	40.6	41.0	39.7	37.8	50.0	48.4	46.4	48.2	46.8	44.9	45.5	44.0	41.9
	85	Sens MBH	27.1	25.5	23.9	34.5	31.9	29.7	39.1	36.7	34.1	30.0	28.2	26.5	38.3	35.3	32.9	43.3	40.7	37.8
		Power KW	3.1	3.0	3.0	3.0	3.0	2.9	2.9	2.9	2.8	3.5	3.4	3.4	3.4	3.4	3.3	3.3	3.3	3.2
D		Total MBH	44.7	43.4	41.5	43.3	41.9	40.2	40.7	39.3	37.4	49.6	48.1	46.0	48.0	46.4	44.5	45.0	43.6	41.5
0	90	Sens MBH	26.7	25.2	23.5	34.3	31.8	29.3	39.0	36.4	34.0	29.6	27.9	26.0	38.0	35.3	32.4	43.2	40.3	37.7
0		Power KW	3.3	3.2	3.1	3.3	3.2	3.1	3.1	3.1	3.0	3.7	3.6	3.5	3.7	3.6	3.5	3.5	3.5	3.4
R		Total MBH	42.5	41.0	39.3	41.1	39.8	38.1	38.6	37.3	35.5	47.0	45.5	43.6	45.6	44.1	42.2	42.7	41.4	39.4
	95	Sens MBH	26.1	24.8	23.2	34.0	30.8	29.0	38.6	36.1	33.5	28.9	27.5	25.7	37.7	35.0	32.1	42.7	40.0	37.1
l _		Power KW	3.3	3.3	3.2	3.3	3.2	3.2	3.2	3.2	3.1	3.7	3.7	3.6	3.7	3.6	3.6	3.6	3.6	3.5
T		Total MBH	41.7	40.3	38.7	40.4	39.0	37.4	37.8	36.6	34.9	46.2	44.6	42.8	44.7	43.3	41.5	41.9	40.5	38.6
E	100	Sens MBH	25.6	24.1	22.4	33.5	30.6	28.2	37.8	36.1	33.5	28.4	26.7	24.8	37.1	34.2	31.3	41.9	40.0	37.1
M		Power KW	3.4	3.4	3.3	3.4	3.3	3.3	3.3	3.3	3.2	3.8	3.8	3.7	3.8	3.7	3.7	3.7	3.7	3.6
P	l	Total MBH	40.1	38.8	37.2	38.9	37.6	36.0	36.4	35.3	33.5	44.4	42.9	41.3	43.1	41.7	39.9	40.3	39.1	37.2
E	105	Sens MBH	25.0	23.4	21.6	32.8	30.2	27.6	36.4	35.3	33.5	27.7	25.9	23.9	36.3	33.5	30.6	40.3	39.1	37.1
R		Power KW	3.5	3.5	3.4	3.5	3.4	3.3	3.4	3.3	3.3	3.9	3.9	3.8	3.9	3.8	3.7	3.8	3.7	3.7
A	140	Total MBH	38.8	37.5	36.0	37.5	36.4	34.9	35.3	34.1	32.5	42.9	41.6	39.9	41.6	40.3	38.6	39.1	37.8	36.0
'	110	Sens MBH	24.3	22.6	20.8	32.1	29.6	26.9	35.3	34.1	32.5	26.9	25.1	23.1	35.6	32.8	29.8	39.1	37.8	36.0
l R		Power KW	3.7	3.7	3.7	3.7	3.7	3.6	3.7	3.6	3.6	4.1	4.1	4.1	4.1	4.1	4.0	4.1	4.0	4.0
E	145	Total MBH	37.5	36.3	34.8	36.3	35.2	33.6	34.0	33.0	31.4	41.6	40.2	38.5	40.2	39.0	37.3	37.7	36.5	34.8
-	115	Sens MBH Power KW	23.6 3.9	21.9 3.8	20.2 3.8	31.5 3.8	28.9 3.8	26.2 3.7	34.0 3.8	33.0 3.7	31.4 3.7	26.1 4.3	24.3 4.2	22.4 4.2	34.9 4.2	32.0 4.2	29.1 4.1	37.7 4.2	36.5	34.8
		Total MBH	36.4	35.2	33.7	35.3	34.1	32.7	33.0	31.9	30.4	4.3	39.0	37.4	39.1	37.8	36.2		4.1 35.4	4.1 33.7
□°F	100																	36.5		l I
'	120	Sens MBH	22.7	20.9	19.4	30.5	28.0	25.5	33.0	31.9	30.4	25.2	23.2	21.5	33.8	31.0	28.2	36.5	35.4	33.7 4.2
		Power KW	4.0	3.9	3.9	3.9	3.9	3.8	3.9	3.8	3.8	4.4	4.3	4.3	4.3	4.3	4.2	4.3	4.2	

				SAD	E060	/SBH	C24H	IBH						SA	DE06	5/SB	HC24	\$HBH		
	INE	OOR TEMP °F	80	DB/71V	VB	80	DB/67V	VB	80	DB/63W	/B	80	DB/71V	VB	80	DB/67W	/B	80	DB/63W	В
	0	FM AIR VOL.	2280	2075	1760	2280	2075	1760	2280	2075	1760	2319	2269	2200	2319	2269	2200	2319	2269	2200
	DI	ep.ratio (1)	0.31	0.33	0.35	0.31	0.33	0.35	0.31	0.33	0.35	0.28	0.29	0.30	0.28	0.29	0.30	0.28	0.29	0.30
		Total MBH	62.0	59.9	57.4	59.9	58.0	55.6	56.2	54.5	51.9	74.4	72.0	69.0	72.0	69.6	66.9	67.5	65.5	62.4
0	80	Sens MBH	37.2	35.0	32.8	47.7	43.7	40.7	53.5	49.4	45.7	44.7	42.1	39.5	57.3	52.5	48.9	64.2	59.4	54.9
U		Power KW	4.0	3.8	3.8	3.8	3.8	3.7	3.8	3.7	3.6	5.0	4.8	4.8	4.8	4.8	4.7	4.8	4.7	4.5
Т	85	Total MBH Sens MBH	61.3 36.8	59.4 34.6	56.9 32.5	59.1 46.9	57.4 43.3	55.1 40.3	55.8 53.2	54.0 49.5	51.4 46.3	73.7 44.3	71.3 41.6	68.4 39.0	71.0 56.4	69.0 52.0	66.2 48.4	67.0 64.0	64.8 59.4	61.8 55.7
	65	Power KW	4.1	4.0	4.0	4.0	4.0	3.8	3.8	3.8	3.7	5.1	5.0	5.0	5.0	5.0	4.8	4.8	4.8	4.7
D		Total MBH	60.8	59.0	56.4	58.9	56.9	54.6	55.3	53.5	50.9	73.0	70.8	67.8	70.7	68.4	65.6	66.4	64.2	61.1
0	90	Sens MBH	36.3	34.3	31.9	46.6	43.3	39.8	53.0	49.4	46.2	43.6	41.2	38.4	56.0	52.0	47.8	63.7	59.4	55.5
0		Power KW	4.3	4.2	4.1	4.3	4.2	4.1	4.1	4.1	4.0	5.5	5.3	5.1	5.5	5.3	5.1	5.1	5.1	5.0
R		Total MBH	57.7	55.8	53.5	55.9	54.1	51.8	52.4	50.8	48.3	69.3	67.0	64.2	67.2	65.0	62.2	63.0	61.0	58.0
	95	Sens MBH	35.4	33.7	31.5	46.2	42.5	39.4	52.4	49.1	45.5	42.6	40.5	37.9	55.6	51.5	47.4	63.0	59.0	54.6
		Power KW	4.3	4.3	4.2	4.3	4.2	4.2	4.2	4.2	4.1	5.5	5.5	5.3	5.5	5.3	5.3	5.3	5.3	5.1
T		Total MBH	56.7	54.7	52.6	54.9	53.1	50.9	51.4	49.7	47.4	68.1	65.8	63.1	65.9	63.8	61.1	61.8	59.7	57.0
E	100	Sens MBH	34.8	32.7	30.4	45.5	42.0	38.4	51.4	49.1	45.5	41.8	39.3	36.5	54.6	50.5	46.1	61.8	59.0	54.6
M P		Power KW	4.5	4.5	4.3	4.5	4.3	4.3	4.3	4.3	4.2	5.6	5.6	5.5	5.6	5.5	5.5	5.5	5.5	5.3
E		Total MBH	54.5	52.7	50.6	52.8	51.1	48.9	49.5	47.9	45.6	65.5	63.3	60.8	63.5	61.4	58.8	59.4	57.6	54.8
R	105	Sens MBH Power KW	34.0 4.6	31.8 4.6	29.4 4.4	44.6 4.6	41.1 4.4	37.5 4.3	49.5	47.9 4.3	45.5 4.3	40.9 5.8	38.2 5.8	35.3 5.6	53.5 5.8	49.4 5.6	45.0 5.5	59.4 5.6	57.6 5.5	54.6 5.5
Α									4.4					0.0		***			0.0	
Т	110	Total MBH Sens MBH	52.7 33.0	51.0 30.8	48.9 28.3	51.0 43.7	49.5 40.2	47.4 36.6	47.9 47.9	46.4 46.4	44.2 44.2	63.3 39.6	61.3 37.0	58.8 34.0	61.3 52.5	59.4 48.3	57.0 44.0	57.6 57.6	55.7 55.7	53.1 53.1
U	110	Power KW	4.8	4.8	4.8	43.7	4.8	4.7	47.9	4.7	44.2	6.1	6.1	6.1	6.1	6.1	5.9	6.1	5.9	5.9
R		Total MBH	51.0	49.3	47.3	49.3	47.8	45.7	46.2	44.8	42.6	61.3	59.3	56.8	59.3	57.4	54.9	55.6	53.9	51.2
E	115	Sens MBH	32.1	29.8	27.4	42.8	39.3	35.7	46.2	44.8	42.6	38.5	35.8	33.0	51.4	47.2	42.9	55.6	53.9	51.2
		Power KW	5.1	4.9	4.9	4.9	4.9	4.8	4.9	4.8	4.8	6.4	6.2	6.2	6.2	6.2	6.1	6.2	6.1	6.1
		Total MBH	49.5	47.8	45.9	47.9	46.4	44.4	44.8	43.4	41.3	59.4	57.4	55.1	57.6	55.7	53.4	53.9	52.2	49.7
°F	120	Sens MBH	30.9	28.5	26.4	41.5	38.0	34.6	44.8	43.4	41.3	37.1	34.2	31.7	49.8	45.7	41.6	53.9	52.2	49.7
		Power KW	5.2	5.1	5.1	5.1	5.1	4.9	5.1	4.9	4.9	6.5	6.4	6.4	6.4	6.4	6.2	6.4	6.2	6.2

POWER KW = UNIT INPUT K.W.

NOTE : ① WHEN THE ENTERING AIR INDOOR DRY BULB IS OTHER THAN 80° F [26.7° C], ADJUST THE SENSIBLE CAPACITY FROM THE TABLE BY ADDING [$1.10 \times CFM \times (1 - DR) \times (dbE - 80)$]

Condensing Unit Refrigerant Line Size Information

				Liquid Lir						Liquid Li			
System	Line		Outdo	or Unit Abo	ve Indoor C	Coil			Outdo	or Unit Bel	low Indoor	Coil	
Model	Size		Т	otal Length	- Feet (m)		Г		Г	Total Lengt	h - Feet (m)		
Numbers	(inch O.D.)	25 [7.26]	50 [15.24]	75 [22.86]	100 [30.48]	125 [38.10]	150 [45.72]	25 [7.62]	50 [15.24]	75 [22.86]	100 [30.48]	125 [38.10]	150 [45.72]
SADE	[mm]		Vertic	al Separatio	n - Feet [m	l			Vert	ical Separa	tion - Feet [m]	
018	1/4* [6.35]	25 [7.62]	50 [15.24]	70 [21.34]				25 [7.62]	23 [7.01]	8[2.44]			
018	5/16 [7.94]				80 [24.39]	90 [27.44]	110 [33.52]			52 [15.85]	52 [15.85]	52 [15.85]	52 [15.85]
004	1/4* [6.35]	25 [7.62]	50 [15.24]					25 [7.62]	23 [7.01]				
024	5/16 [7.94]			34 [10.36]	70 [21.34]	90 [27.44]	110 [33.52]		55 [16.76]	52 [15.85]	52 [15.85]	52 [15.85]	52 [15.85]
	1/4* [6.35]	25 [7.62]	50 [15.24]					25 [7.62]	23 [7.01]				
030	5/16 [7.94]			33 [10.06]	70 [21.34]	61 [18.59]			50 [15.24]	39 [11.89]	25 [7.62]	11 [3.35]	
	3/8 [9.53]					90 [27.44]	110 [33.52]						52 [15.85]
036	5/16* [7.94]	25 [7.62]	50 [15.24]	70 [21.34]				25 [7.62]	23 [7.01]	9 [2.74]			
036	3/8 [9.53]				70 [21.34]	90 [27.44]	110 [33.52]			52 [15.85]	52 [15.85]	52 [15.85]	52 [15.85]
0.40	5/16* [7.94]	25 [7.62]	50 [15.24]	75 [22.86]				25 [7.62]	23 [7.01]	9 [2.74]			
042	3/8 [9.53]				70 [21.34]	90 [27.44]	110 [33.52]			55 [17.56]	52 [15.85]	52 [15.85]	52 [15.85]
048	3/8* [9.53]	25 [7.62]	44 [13.41]	53 [16.15]	61 [18.59]	70 [21.34]		25 [7.62]	23 [7.01]	19 [5.79]	11 [3.35]	3 [.91]	
048	1/2 [12.7]					90 [27.44]	110 [33.52]					52 15.85]	52 [15.85]
060	3/8* [9.53]	25 [7.62]	48 [14.63]	61 [18.59]	72 [21.95]			25 [7.62]	23 [7.01]	11 [3.35]	3 [.91]		
065	1/2* [12.7]				80 [24.39]	90 [27.44]	110 [33.52]				52 [15.85]	52 [15.85]	52 [15.85]

*Standard line size

NOTES:

1. This chart is applicable for condensing units.

- Do not exceed 120 feet [36.58m] maximum vertical separation,
 Always use the smallest liquid line possible to minimize system charge.
 Chart may be used to size horizontal runs.
- 5. The, total length upto 150ft [45,72m] permissble with minimim number of fitting in the pipe line and enhance pipe sizes as per tables.

1. This chart is applicable for condensing units.

Example 1:A 2.5 ton [8.79kW] condensing unit with a total line length of 75 feet [22.86m] with a vertical separation of 30 feet [9.14m] requires a liquid line size of 5/16 [7.94mm].

2. This chart may also be used to size horizontal runs.

Example 2: A 5 ton [17.58kW] condensing unit may have a total horizontal run of 100 feet [30.48m] if using the 3/8 [9.53mm] liquid line. The total horizontal run of using 1/2 [12.7mm] liquid line size will be 150 feet [45.72m].

- 3. Do not exceed vertical separation as indicated on the chart.
- 4. The, total length upto 150ft [45,72m] permissble with minimim number of fitting in the pipe line and enhance pipe sizes as per tables.

		Va	por Line Length	/ Size versus C	apacity Multipli	er		
SAD	E	018	024	030	036	042	048	060/065
Vapor Line F	Run-feet [m]	5/ ₈ " [15.88 mm] O.D. Standard 3/ ₄ " [19.05mm] O.D. Optional		³ / ₄ " [19.05mm] O.D Optional] O.D. Standard n] O.D. Optional		1 _{1/8} " [28.58mm]	O.D. Optional O.D. Standard O.D. Optional
	Optional	-	.98	-	-	-	.99	.98
25' [7.62]	Standard	1.00	1.00	1.00	1.00	1.00	1.00	1.00
	Optional	1.01	1.01	1.01	1.01	1.01	1.01	1.01
	Optional	-	.96	-	-	-	.97	.97
50' [15.24]	Standard	.98	.99	.99	.98	.97	1.00	.99
	Optional	1.00	1.00	1.00	1.00	1.00	1.01	1.01
	Optional	-	.93	-	-	-	.96	.95
100' [30.48]	Standard	.96	.98	.97	.96	.94	.99	.99
	Optional	.99	.99	.99	.99	.98	1.00	1.00
	Optional	-	-	-	-	-	.93	.91
150' [45.72]	Standard	.97	.97	.95	.93	.90	.99	.98
	Optional	.98	.98	.97	.97	.96	1.00	.99

NOTES: Capacity Multiplier x Rated Capacity = Actual Capacity.

Additional Compressor Oil is not required for runs up to 150 feet (45.72 m). See Liquid Line Chart for Vertical Separation requirements and limitations.

[] Designates Metric Conversions

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

RHEEM **AIR CONDITIONING DIVISION**

5600 Old Greenwood Road, Fort Smith, Arkansas 72906, U.S.A.